


**NOTE:**  
CLEAN & PAINT VALVE CAN LIDS  
HYDRANT - RED  
WATER MAIN - BLUE

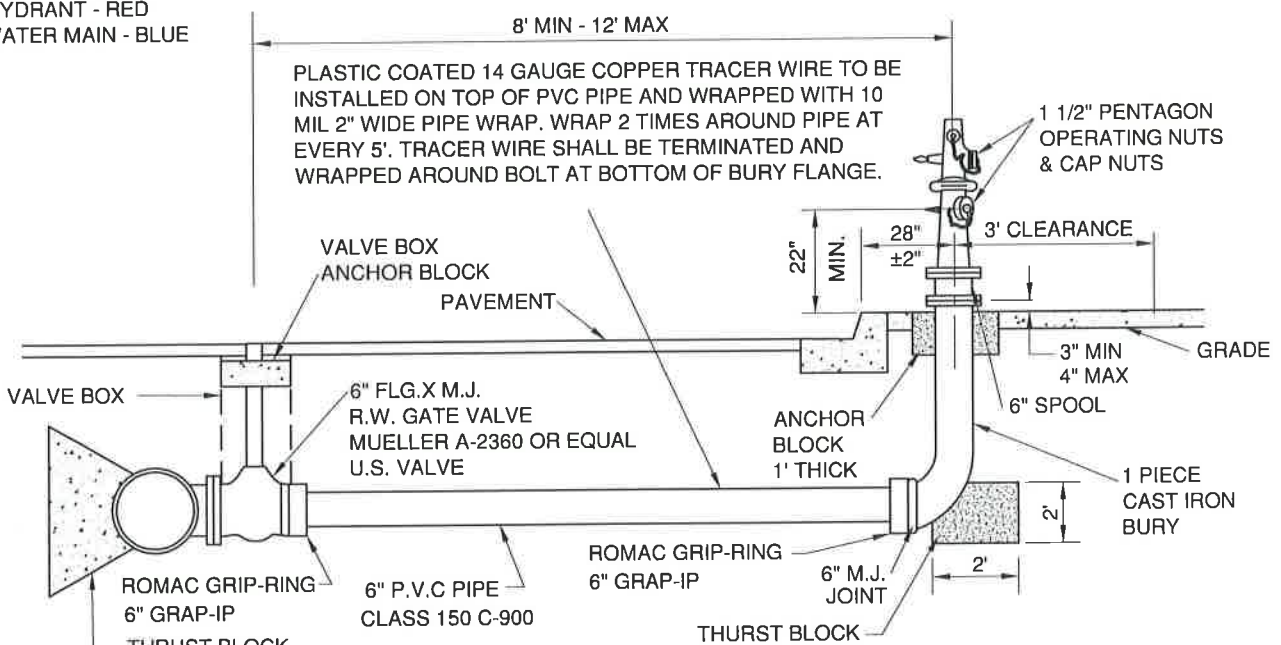

- NOTES:**
1. MINIMUM DISTANCE BETWEEN HYDRANT AND DRIVEWAY TOP OF "X" = 4'
  2. HYDRANT INSTALLATION SHALL BE PER STANDARD WATER NOTES
  3. THRUST BLOCKS SHALL BE 5-B-2000
  4. MINIMUM VALVE OPENING 5 1/4"
  5. EXISTING SIDEWALK SHALL BE SAWCUT ALONG SCORE LINES AND REPLACED AS REQUIRED BY HYDRANT INSTALLATION
  6. WHERE SIDEWALK IS LESS THAN 6' WIDE, HYDRANT SHALL BE INSTALLED AS DIRECTED BY CITY ENGINEER
  7. INSTALL HOLLOW SHEAR BOLTS ON TOP & BOTTOM FLANGES OF SPOOL ON HYDRANT NUTS UP-FILL BOLTS WITH GREASE
  8. INSTALL VALVE MARKER & ARROW & RAISED BLUE MARKER PER STD # 417
  9. FIRE HYDRANT SHALL BE INSTALLED **PRE-PAINTED** FROM MANUFACTURER, WITH COLOR LS 345 SAFETY YELLOW. ANY NECESSARY TOUCH UP SHALL BE OF SAME COLOR AT END OF CONSTRUCTION

APPROVED:  
*Wanda Yonson*  
P.W. DIRECTOR / CITY ENGINEER

REVISED DATE: 5/11/16

**City of Westminster**  
DEPARTMENT OF PUBLIC WORKS

**FIRE HYDRANT AND HYDRANT VALVE INSTALLATION**

STANDARD NUMBER  
**404**