


STAGGER SADDLES FOR WATER SERVICES AROUND CIRCUMFERENCE OF PIPE SPACED 12" APART (MIN).

TYPICAL PLAN VIEW

HYDRANT TO BE 2 PART ASSEMBLY OR APPROVED EQUAL. JONES J-3765R.

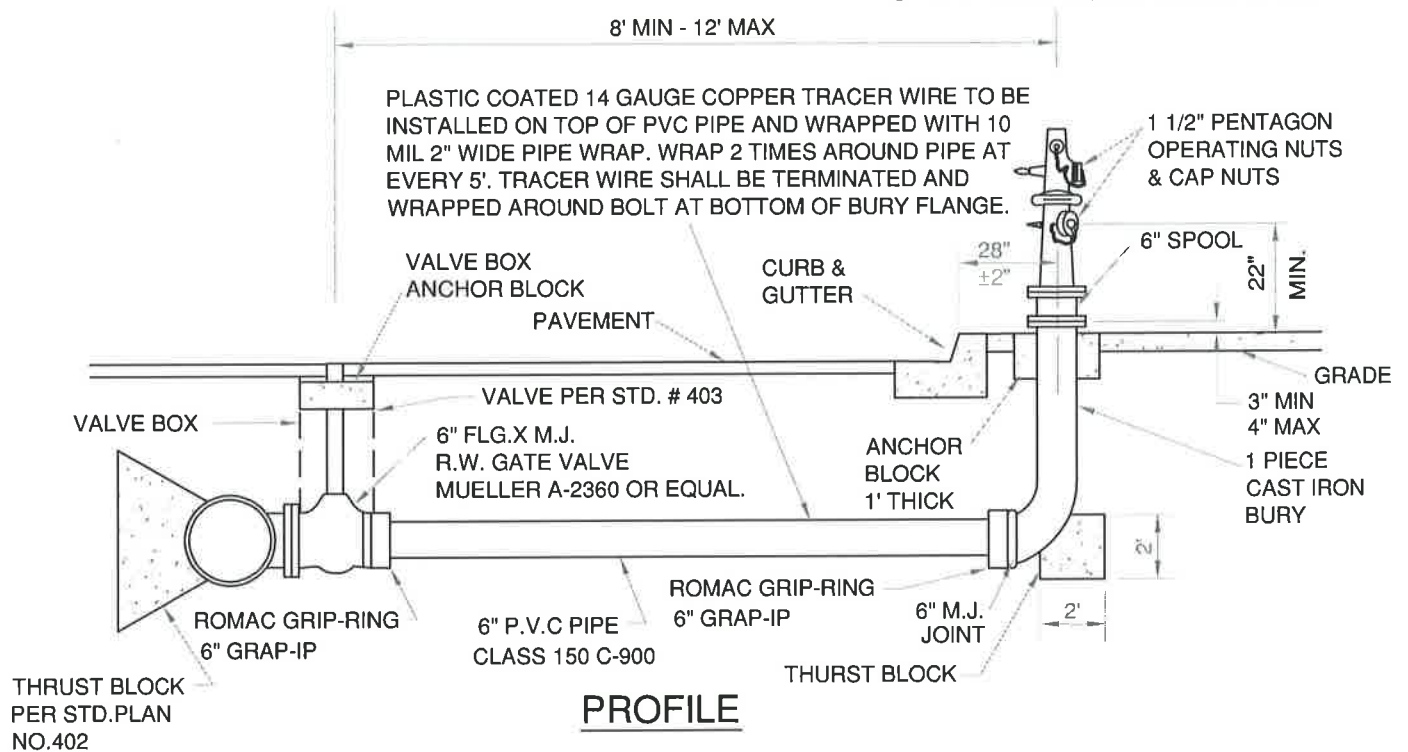

PROFILE

NOTES:

1. FIRE HYDRANT SHALL BE PLACED AT PROPERTY LINE / OR AS APPROVED BY THE CITY ENGINEER.
2. FIRE HYDRANT VALVE SHALL BE PER STD #404.
3. NO SERVICES SHALL BE TAPPED OFF A FIRE HYDRANT RUN.

APPROVED:

Manu Youssef
P.W. DIRECTOR / CITY ENGINEER



City of Westminster

DEPARTMENT OF PUBLIC WORKS

END OF LINE CONNECTIONS

STANDARD NUMBER

407

REVISED DATE: 5/11/16