


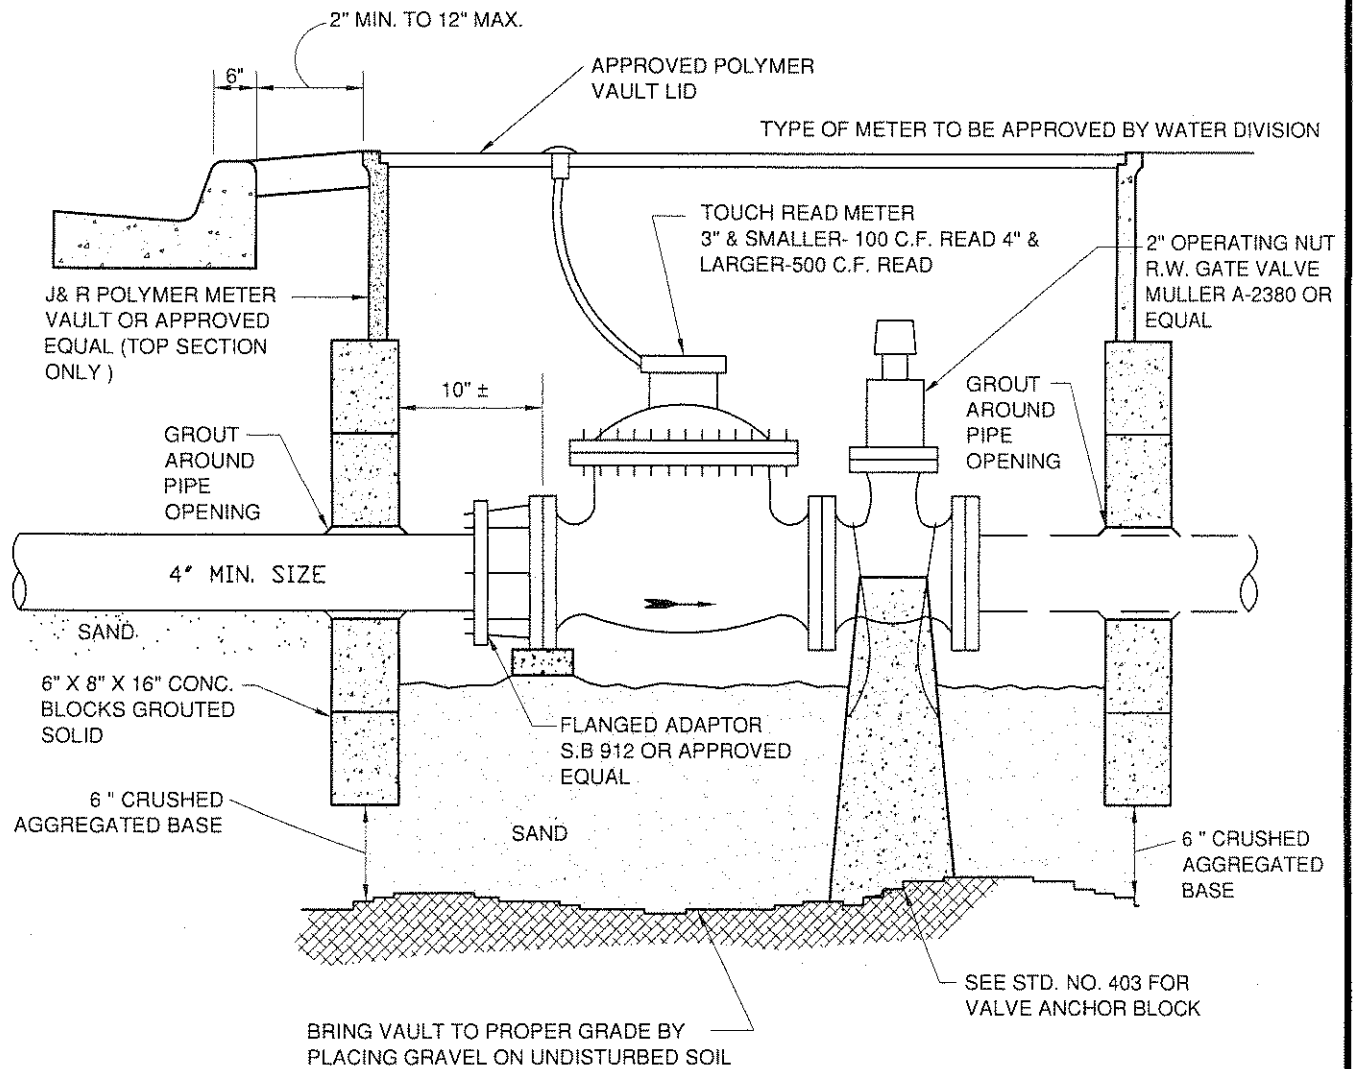

NOTE:

- * TAPPING MUELLER VALVE OR OTHER VALVE MUST BE INSTALLED BETWEEN METER VAULT & MAIN LINE.
- * VALVE TO BE INSTALLED PER STANDARD #403 ADJACENT TO WATER MAIN.

APPROVED:

Marwan Youssef
P.W. DIRECTOR / CITY ENGINEER



REVISED DATE: 5/15/08

City of Westminster

DEPARTMENT OF PUBLIC WORKS

**3" AND LARGER
METERED WATER SERVICE**

STANDARD NUMBER

408