


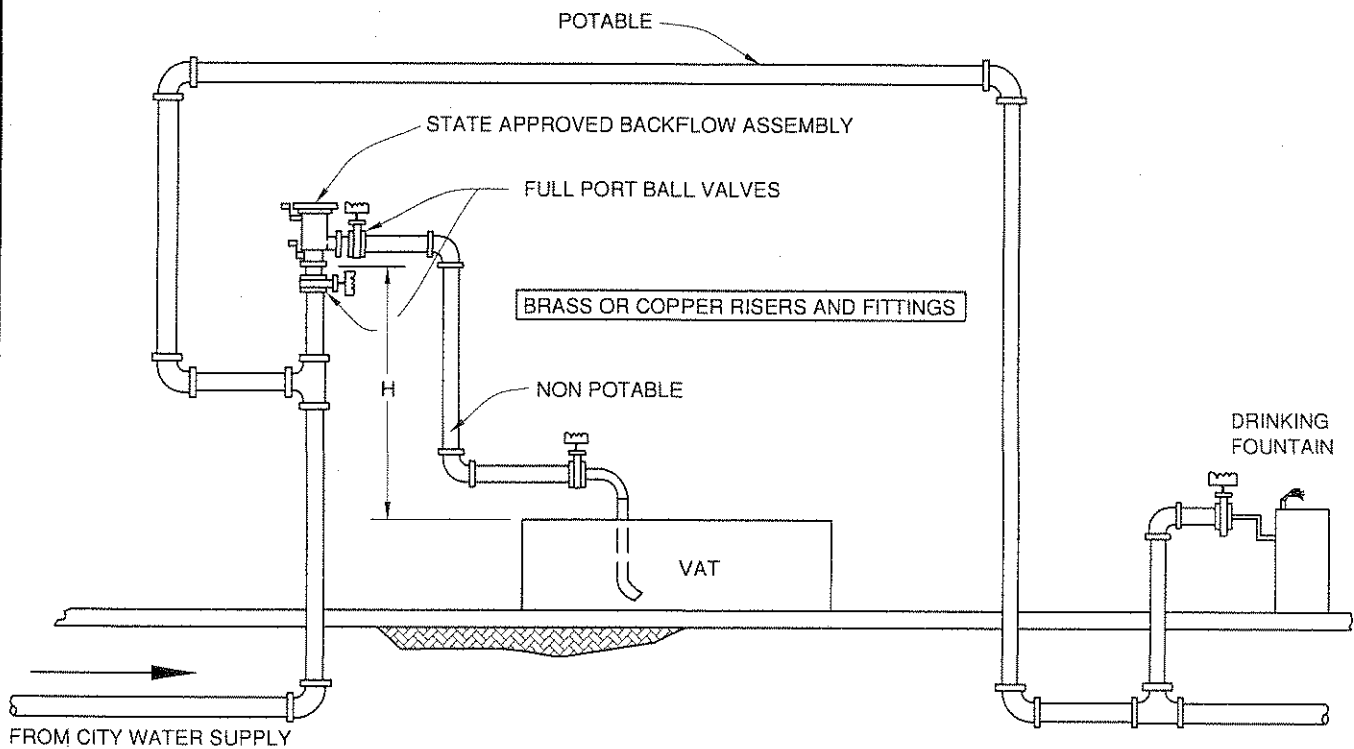

"H" MINIMUM HEIGHT OF UNIT SHALL BE 12" ABOVE HIGHEST FLOW LEVEL, RIM OF TANKS, VATS, OR BASINS. (SPECIAL CONDITIONS MAY REQUIRE MORE HEIGHT)

NOTE: ELEVATION OF DEVICE AND LATERAL CLEARANCE OF TEST OULETS SHALL BE SUCH THAT DEVICE CAN BE CONVENIENTLY TESTED.

SMALL AMOUNTS OF WATER MAY OCCASIONALLY DISCHARGE FORM DEVICE.

APPROVED:

*Mamie Youssef*  
P.W. DIRECTOR / CITY ENGINEER



REVISED DATE: 5/15/08

**City of Westminster**

DEPARTMENT OF PUBLIC WORKS

RECOMMENDED INSTALLATION  
FOR PRESSURE TYPE  
VACUUM BREAKERS

STANDARD NUMBER

411