


WATER SIPHON DETAIL

N.T.S.

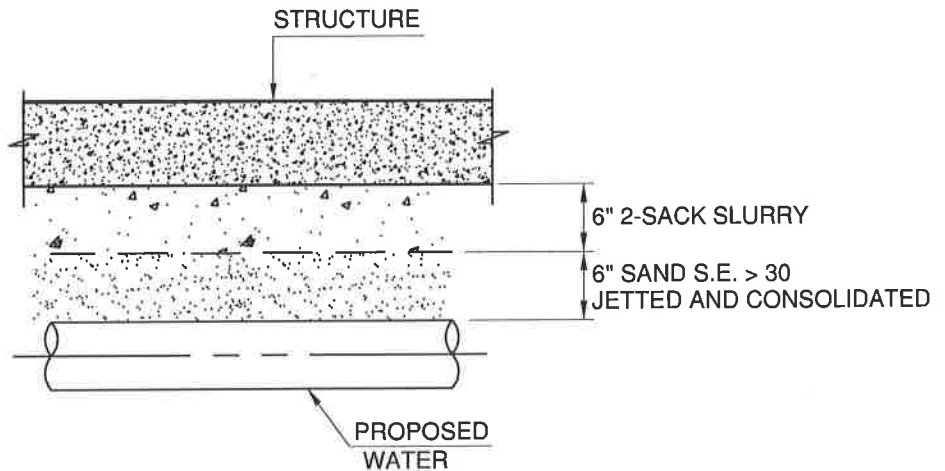

BACKFILL DETAIL

N.T.S.

NOTE:

1. WHEN THE WATER MAIN IS 8 INCHES OR GREATER, THE SIPHON MATERIAL SHALL BE CML&C.
2. WHEN THE WATER MAIN IS LESS THAN 8 INCHES, THE SIPHON MATERIAL SHALL BE PVC C900.
3. THE CONTRACTOR SHALL PASS THE HYDROSTATIC PRESSURE, CHLORINATION, AND BACTERIOLOGICAL TESTING PRIOR TO CONNECTING THE PROPOSED WATER SIPHON TO THE EXISTING WATER MAIN.

APPROVED:

M. J. Young
P.W. DIRECTOR / CITY ENGINEER

REVISED DATE: 5/11/16



City of Westminster

DEPARTMENT OF PUBLIC WORKS

WATER SIPHON DETAIL

STANDARD NUMBER

424