


SIDEWALK ADJACENT TO CURB

WEAKENED PLANE JOINTS IN C&G AT 10' (TYP.)

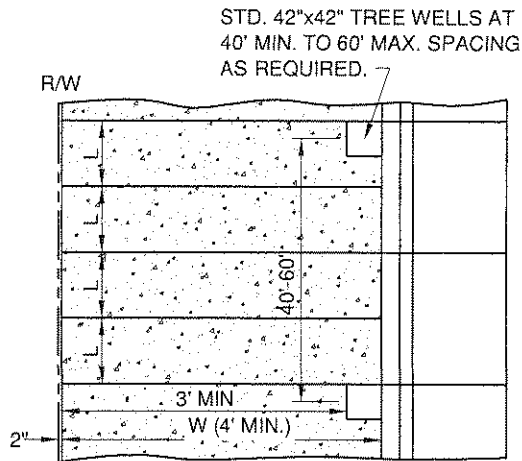

SIDEWALK WITH TREE WELL

NOTES:

1. ARTERIAL L = 10' MAX.
2. SIDEWALK THICKNESS SHALL BE 4" EXCEPT WITHIN ALL DRIVEWAY APPROACHES WHERE THICKNESS SHALL BE 8" MIN.
3. A SAND BEDDING ( S.E. >30), 4" THICK WITH 90% COMPACTION, SHALL BE PLACED WHERE REQUIRED BY SOILS REPORT OR AS DIRECTED BY THE CITY ENGINEER.
4. SIDEWALK SHALL HAVE A LIGHT BROOM FINISH AS APPROVED BY THE CITY ENGINEER.
5. SURFACE SCORING SHALL MATCH THE ADJACENT PATTERN OR AS DIRECTED BY THE CITY ENGINEER.
6. FOR TREE WELLS SEE STANDARD PLAN NO. 600 AND 601.
7. ALL CONCRETE SHALL BE P.C.C. 520-C-2500.
8. TREE WELLS ARE NOT TO BE LOCATED CLOSER THAN 100' FROM B.C.R.
9. PROVIDE 36" MINIMUM CLEARANCE AROUND OBSTACLES.

APPROVED:

*Wanda Yonuse*  
P.W. DIRECTOR / CITY ENGINEER



**City of Westminster**

DEPARTMENT OF PUBLIC WORKS

ARTERIAL SIDEWALK

STANDARD NUMBER

203

REVISED DATE 5/15/08